



TO RETAIN A MAX. OF 350 MM SAND

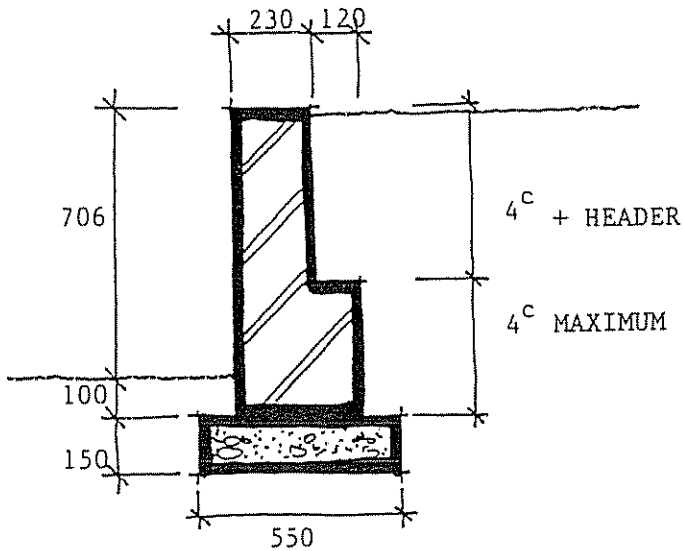

TO RETAIN A MAX. OF 700 MM SAND

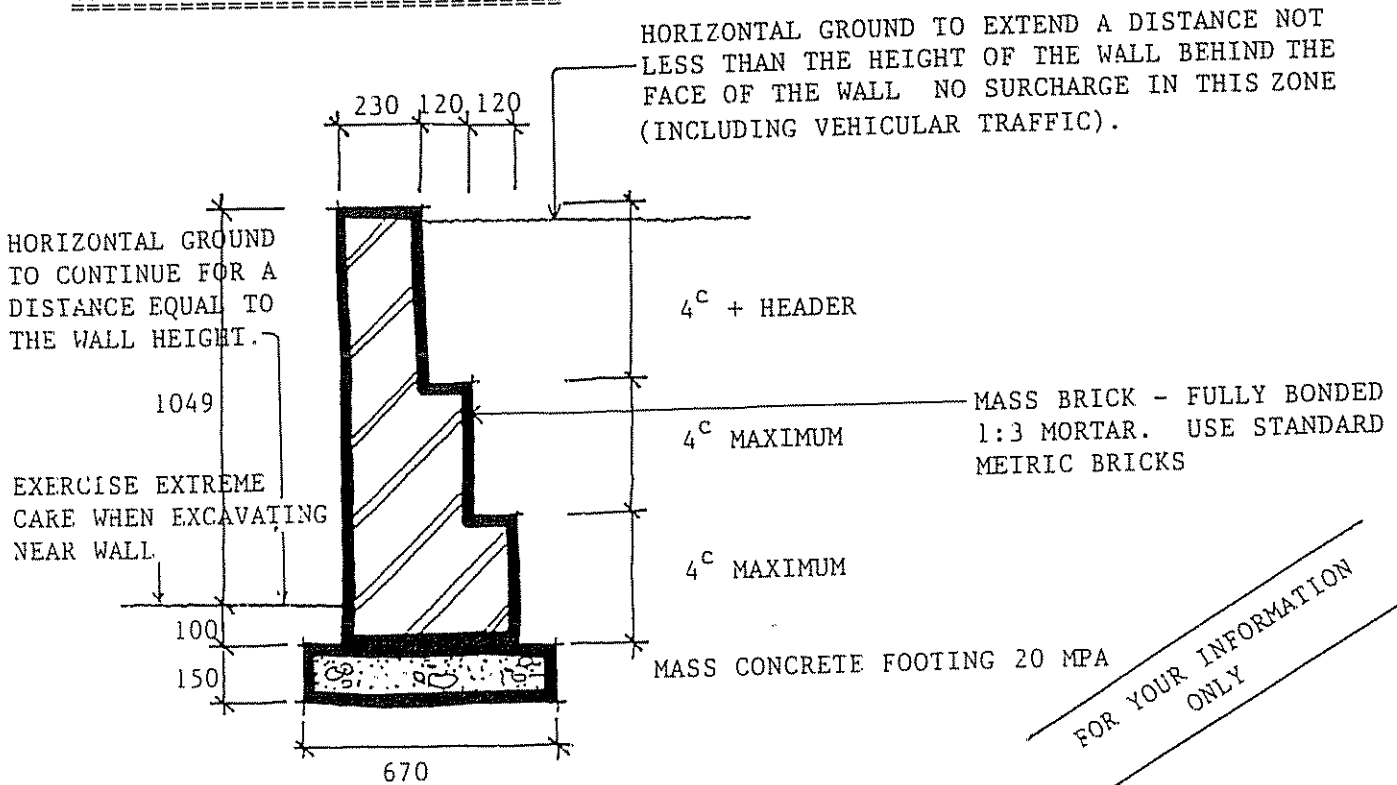


TO RETAIN A MAX. OF 1000 MM SAND

NOTES:

1. Walls retaining less than 450 mm of soil do not require Council approval.
2. Walls retaining more than 450 mm of soil do require Council approval.
3. Walls retaining more than 1000 mm of soil require an original signed copy of a Structural Engineers Certificate to accompany the application (NOTE: The only Structural Engineer recognised by Council is a Practising Member of the Institute of W.A.)
4. Cut and/or fill exceeding 1000 mm in height requires approval through a full Meeting of Council.
5. Walls designed for domestic use in sand areas.
6. Minimum compaction to be 6 blows per 300 mm to 900 mm deep and extend 1200 mm beyond face of wall.
7. All backfill to be clean sand.
8. Do not backfill until wall is seven (7) days old.

FOR YOUR INFORMATION ONLY

# TYPICAL MASS RETAINING

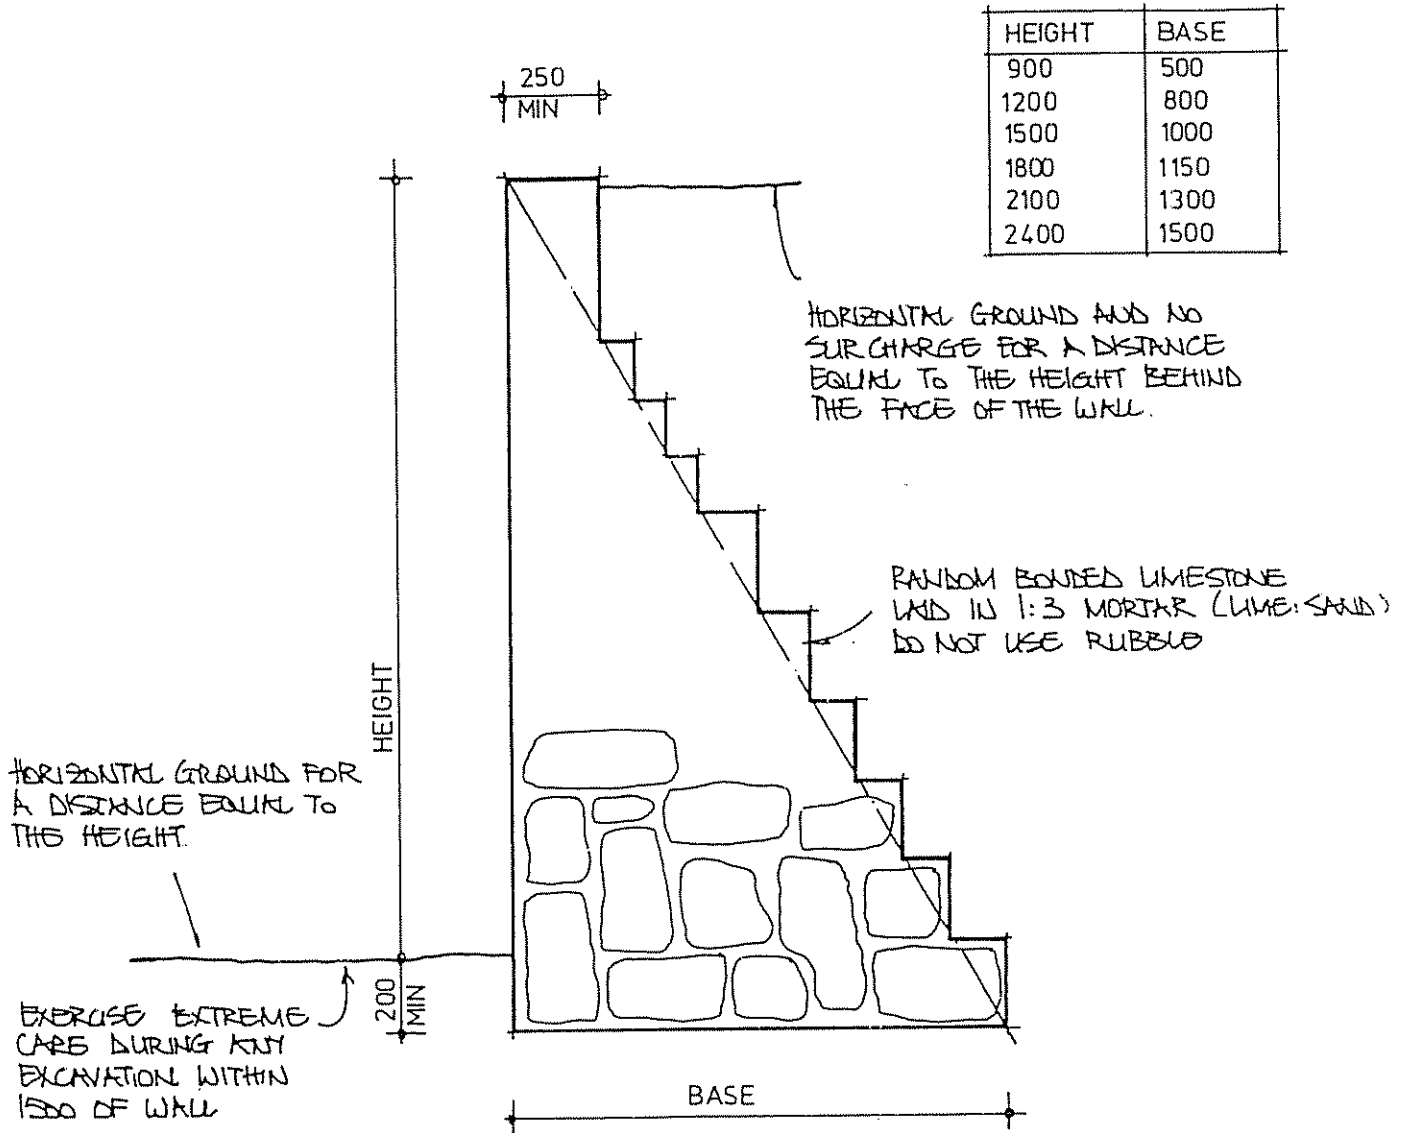

## LIMESTONE RETAINING WALL

1. WALL DESIGNED FOR DOMESTIC USE IN SAND AREAS ONLY.
2. MIN COMPACTION TO BE 6 BLOWS / 300 TO 900 DEEP AND EXTENDING 1200 BEYOND FACE OF THE WALL.
3. ALL BACKFILL TO BE CLEAN SAND.
4. DO NOT BACKFILL UNTIL WALL IS 7 DAYS OLD.